


Joint Systems

System No. HW-D-1165

CAN / ULC S115

F Rating - 3 Hr
FT Rating - 3 Hr
FH Rating - 0 Hr
FTH Rating - 0 Hr
Nominal Joint Width - 75 mm
Class II and III Movement Capabilities: 15% Compression or Extension

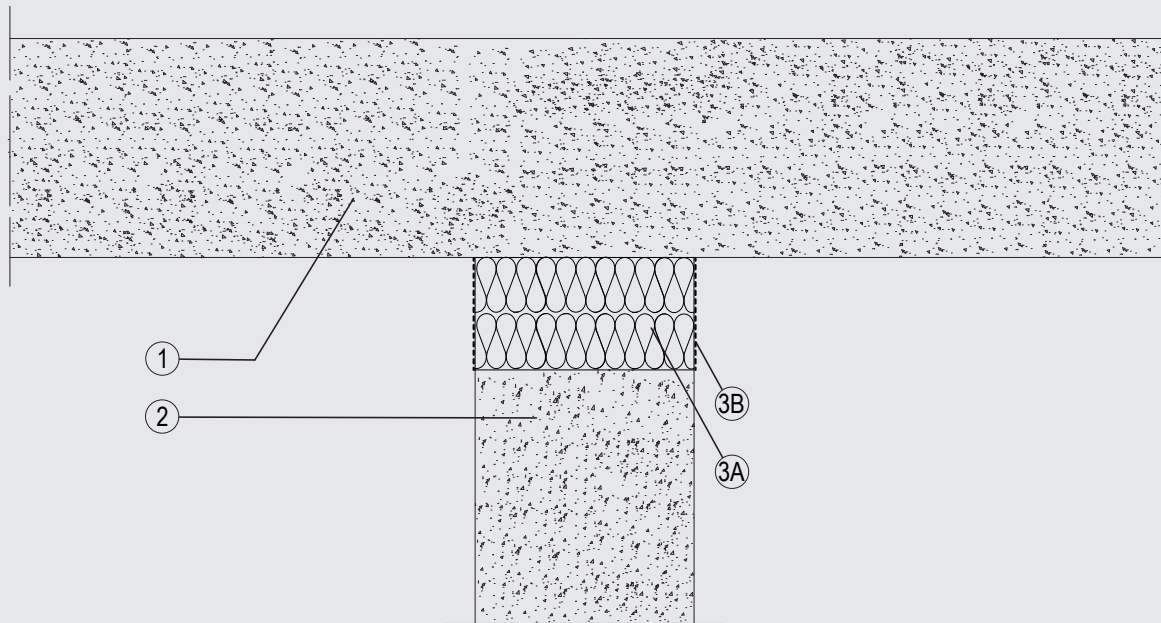

1. Floor Assembly

Min. 115 mm thick reinforced lightweight or normal weight (1600-2400 kg/m) structural. Floor may also be constructed of any min. 152 mm thick UL Classified hollow-core Precast Concrete Units*.

See Precast Concrete Units (CFTV) category in the Fire Resistance Directory for names of manufacturers.

2. Wall Assembly

Min. 115 mm thick lightweight or normal weight (1600-2400 kg/m) structural concrete. Wall may also be constructed of any UL Classified Concrete Blocks*.

See Concrete Blocks (CAZT) category in the Fire Resistance Directory for names of manufacturers.

3. Joint System

Max separation between bottom of floor assembly and top of concrete wall at time of installation is 75 mm and is designed to accommodate a max 15 percent compression or extension from its installed width. The joint system shall consist of the following:

- A. Mineral and Fiber Boards* – Min. 107 mm thickness of min 64 kg/m mineral wool batt insulation cut to required width and installed edge-first into the joint opening, parallel with the joint direction, such that batt sections are compressed min. 50 percent in thickness and that the compressed batt sections are recessed from both surfaces of wall as required to accommodate the required thickness of fill material (Item 3B).

Fujairah Rockwool Factory – SXXX

- B. Fill, Void or Cavity Material* – Sealant – Min. 4 mm thickness of fill material applied within the joint, flush with each surface of the wall.

Flamro Brandschutz-Systeme GmbH – BIOFERM A

*Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively. Reprinted from Product iQ with permission from UL Solutions. ©2025 UL LLC.