


Through-penetration Firestop Systems

System No. W-J-1286

ANSI/UL1479 (ASTM E814)	CAN / ULC S115
F Rating – 3 Hr	F Rating – 3 Hr
T Rating – 0 Hr	FT Rating – 0 Hr
	FH Rating – 3 Hr
	FTH Rating – 0 Hr

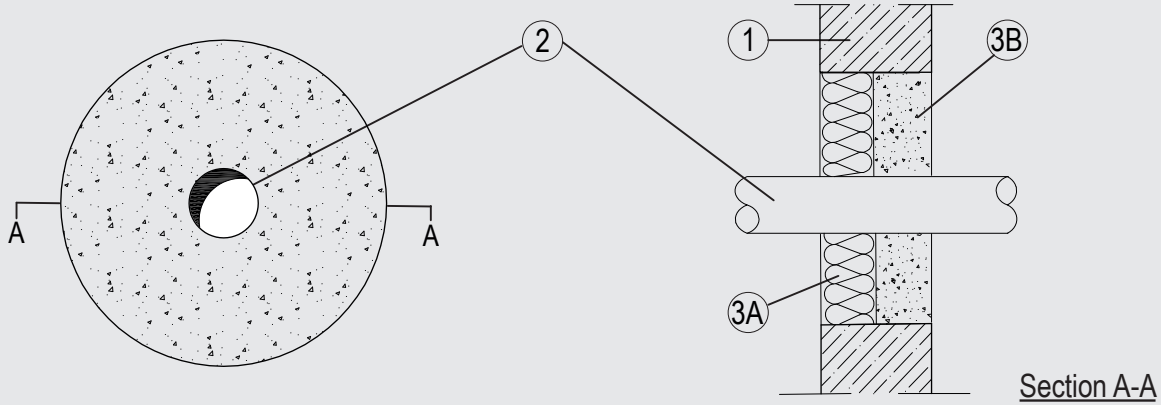

1. Wall Assembly

Min. 4-1/2 in. (115 mm) thick lightweight or normal weight (100-150 pcf or 1600 - 2400 kg/m³) concrete. Wall may also be constructed of any UL Classified Concrete Blocks*. Opening shall be rectangular or circular with max dimensions of 5-1/4 in. (132 mm).

See Concrete Blocks (CAZT) in the Fire Resistance Directory for names of manufacturers.

2. Pipes/ Tubes

Single to be installed within the opening. The annular space between the pipes and the periphery of the opening to be 2 in (50 mm). Pipes to be rigidly supported on both sides of the wall assembly. The following penetrants may be used:

- A. Max 1-1/4 in. (32 mm) diameter Schedule M (or heavier) copper pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.
- B. Max 1-1/4 in. (32 mm) diameter Schedule 5 (or heavier) steel pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.

3. Through-Penetration Firestop System

The Through-Penetration Firestop System shall consist of the following:

- A. Packing material – Nom. 2-3/8 in. (60 mm) thick mineral wool board min. 9.3 pcf (150 kg/m³), firmly packed into the opening of the wall as a permanent form flush to one face of the wall.
- B. Fill, Void or Cavity Material* – Mortar - Nom 2-1/8 in. (55 mm) cast in to aperture in the wall flush to one face of the wall and around the services.

Flamro Brandschutz-Systeme GmbH – GFM

*Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively. Reprinted from Product iQ with permission from UL Solutions. ©2024 UL LLC.